



TOP VIEW

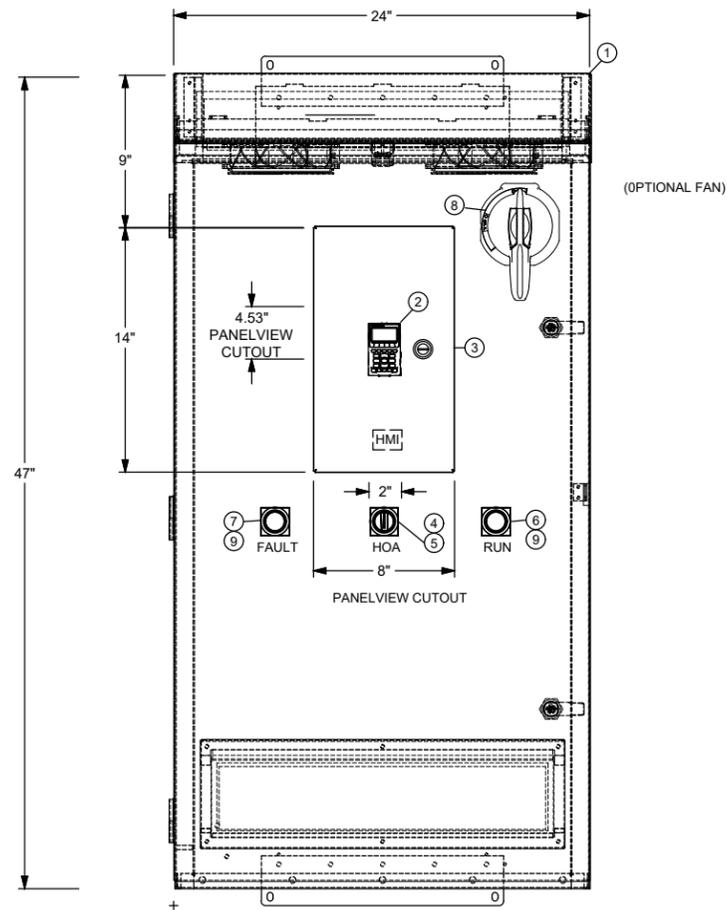

FRONT VIEW

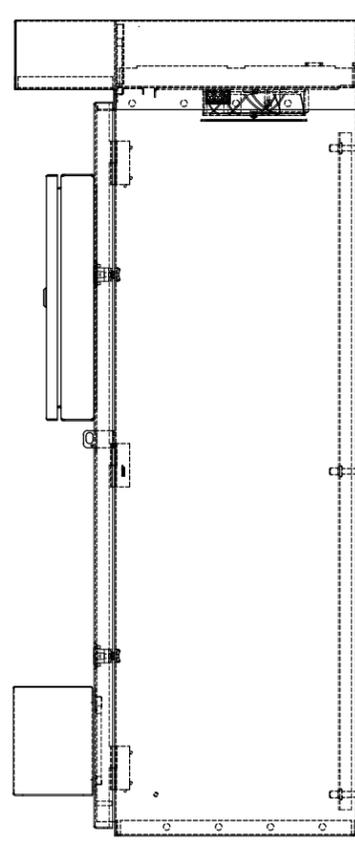

SIDE VIEW

SIDE VIEW

ITEM#	QTY.	DESCRIPTION	PART NUMBER	MANUFACTURER
1	1	POLYSAFE STANDARD ENCLOSURE 24" X 47" X 12"	WF40LP	HOFFMAN
2	1	PowerFlex Architecture Class Enhanced HIM, NEMA 1	20-HIM-A6	ALLEN-BRADLEY
3	1	Exterior Door Mounted Box for HMI Display	3809N112	ALLEN-BRADLEY
4	1	HOA SWITCH	800T-J2A	ALLEN-BRADLEY
5	1	CONTACT BASE FOR J2A		ALLEN-BRADLEY
6	1	GREEN PILOT LIGHT		ALLEN-BRADLEY
7	1	AMBER PILOT LIGHT		ALLEN-BRADLEY
8	1	Operating Mechanisms, 140G Rotary, Rotary Handle	140G-G-RVM12B	ALLEN-BRADLEY
9	1	CONTACT BASE FOR PILOT LIGHT	140G-G-RVM12B	ALLEN-BRADLEY

PANEL COATING

ALL PANELS SHOULD BE COATED EXTERNALLY WITH AN ACRYLIC ALIPHATIC URETHANE FOR UV CHEMICAL PROTECTION WITH THE FOLLOWING REFERENCE.

ITEM	DESCRIPTION
PANEL APPLICATION COATING	PITTHANE ULTRA 95-812 (PORCELAIN WHITE)
COATING	PITTHANE ULTRA 95-819

NO EXCEPTION SHALL BE MADE FOR THE PANEL APPLICATION COATING AND COATING ITEMS REFERENCED ABOVE.

TAG "A"
VFD-XXXX

TAG "B"
SUPPLY CIRCUIT
VOLTAGE: 480AC
MAIN CIRCUIT BREAKER RATING 125A

TAG "C"
CAUTION
MAIN CIRCUIT BREAKER "CB-1"
MUST BE IN OFF POSITION
BEFORE SERVICING ENCLOSURE

DWG.	REV. A	SCALE	3/8"=1'-0"	JOB NO.		DRAWN BY:		FILE:		NO.	A	FOR APPROVAL		REVISION/ISSUE		BY	JON	CHK	REVIEW	APPR.	DATE	DWG. NO.	REFERENCE DRAWINGS
------	--------	-------	------------	---------	--	-----------	--	-------	--	-----	---	--------------	--	----------------	--	----	-----	-----	--------	-------	------	----------	--------------------

ENGINEERING AND DESIGN
TEXAS REGISTERED
ENGINEERING FIRM 4098



MIDLAND, TEXAS

