



TOP VIEW

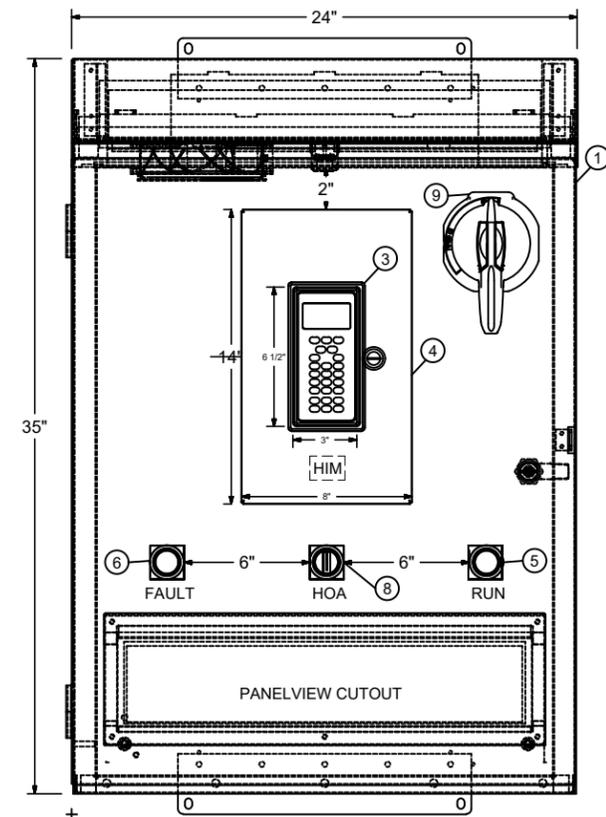

FRONT VIEW

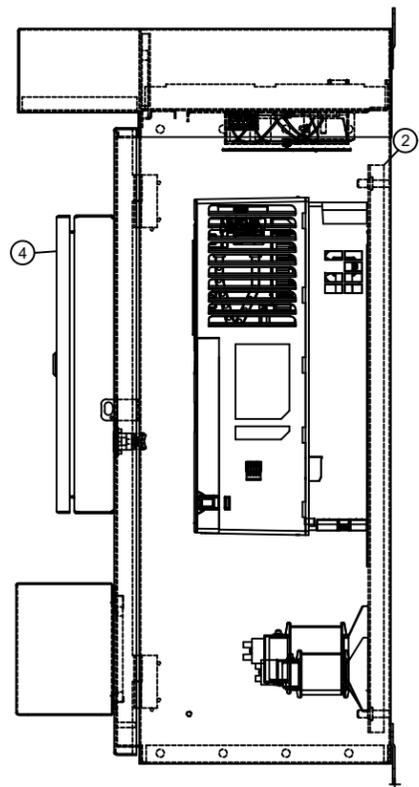

SIDE VIEW

BILL OF MATERIAL

ITEM#	QTY.	DESCRIPTION	PART NUMBER	MANUFACTURER
1	1	WeatherFlo with Fan Type 3R, 35.00x24.00x12.00, White, Steel	WF10LP	HOFFMAN
2	1	Panel for Type 3R 4 4X 12 13 Enclosure, flts 30x24, White, Steel	A30P24	HOFFMAN
3	1	PFlex 20 IP66-UL NemaType 4X-12	20-HIM-C6S	ALLEN-BRADLEY
4	1	14"HX8"WX2.75"	R112219K-1	ALLEN-BRADLEY
5	1	GREEN PILOT LIGHT	ALBR800TQH2G	ALLEN-BRADLEY
6	1	AMBER PILOT LIGHT	ALBR800TQH2A	ALLEN-BRADLEY
7				
8	1	S-SW 3 POSITION KNOB	A-8 800T.J2A	ALLEN-BRADLEY
9	1	Operating Mechanisms, 140G Rotary, Rotary Handle	140G-H-RVM12R	ALLEN-BRADLEY
10	1	"RUN" NAMEPLATE		VENDOR
11	1	"H.O.A." NAMEPLATE		VENDOR
12	1	"FAULT" NAMEPLATE		VENDOR

PANEL COATING	
ALL PANELS SHOULD BE COATED EXTERNALLY WITH AN ACRYLIC ALIPHATIC URETHANE FOR UV CHEMICAL PROTECTION WITH THE FOLLOWING REFERENCE.	
ITEM	DESCRIPTION
PANEL APPLICATION COATING	PITTHANE ULTRA 95-812 (PORCELAIN WHITE)
COATING	PITTHANE ULTRA 95-819
NO EXCEPTION SHALL BE MADE FOR THE PANEL APPLICATION COATING AND COATING ITEMS REFERENCED ABOVE.	

TAG "A"
VFD-XXXX

TAG "B"
SUPPLY CIRCUIT
VOLTAGE: 480AC
MAIN CIRCUIT BREAKER RATING 125A

TAG "C"
CAUTION
MAIN CIRCUIT BREAKER "CB-1"
MUST BE IN OFF POSITION
BEFORE SERVICING ENCLOSURE

ENGINEERING AND DESIGN
TEXAS REGISTERED
ENGINEERING FIRM 4098

EDC
CONSULTANTS, INC.

MIDLAND, TEXAS 79701

REV. A | SCALE 3/8"=1'-0" | JOB NO. _____ | DRAWN BY: _____ | FILE: _____

DWG. NO. _____ | FOR APPROVAL NO. _____ | REVISION/ISSUE _____ | DATE _____ | BY: _____ | CHK: _____ | REVIEW/APPR. _____ | DWG. NO. _____ | REFERENCE DRAWINGS _____